




## No Headers in Nonbearing Walls - Code Notes

The use of header stock over windows and doors in nonbearing walls is typical construction practice throughout the industry. But a single two-inch by four-inch board is allowed to be used as a header in non-load bearing wall systems. This practice is unfamiliar to many in the enforcement and building industry.

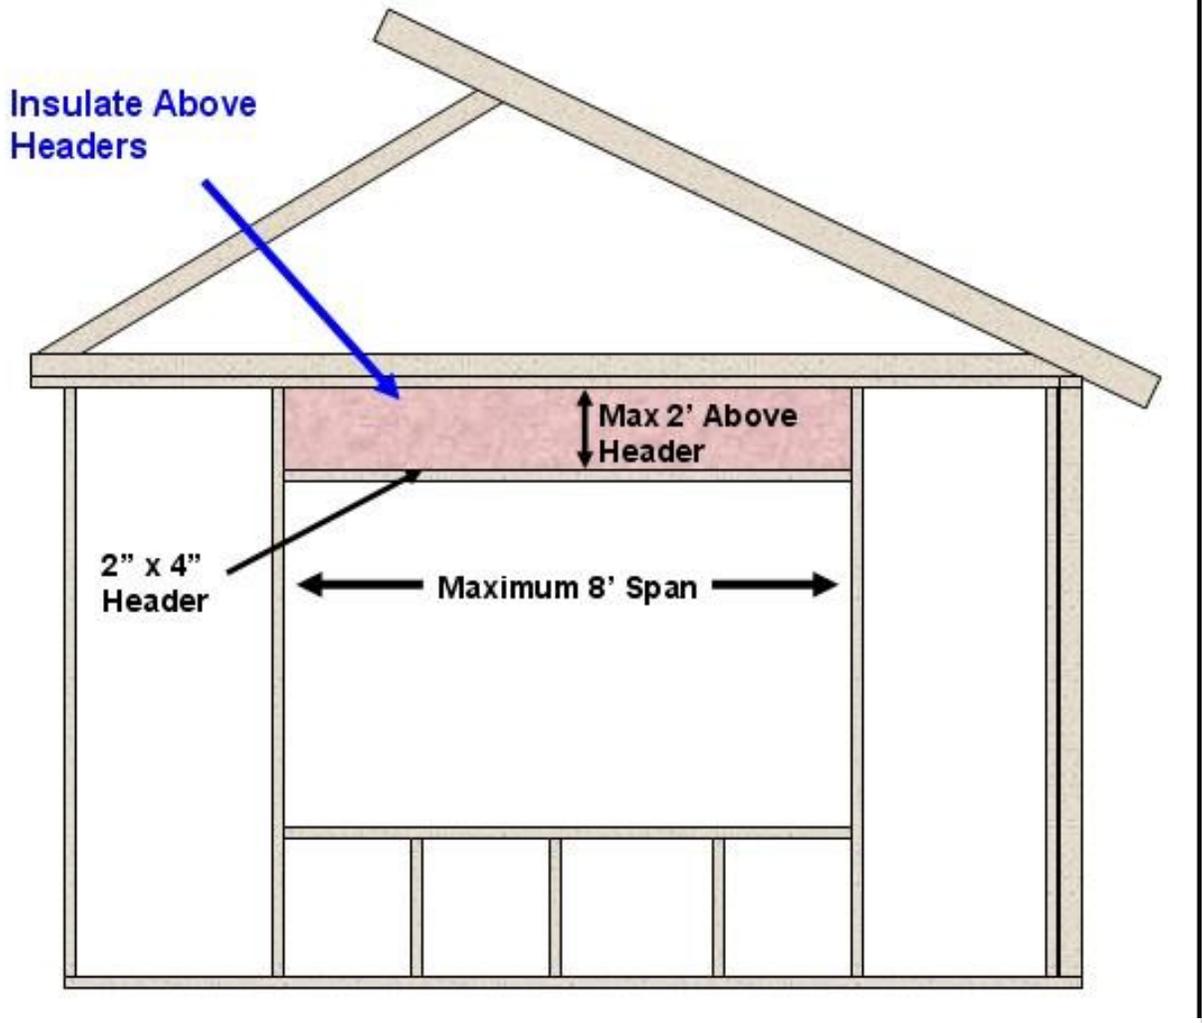

Eliminating unnecessary wood framing within walls can increase the thermal efficiency of the wall system. Less framing allows more insulation to be installed, and eliminates hot and cold spots (from thermal bridging through the frame) within the wall system.

A single, flat two-inch by four-inch board may be used as a header in an exterior or interior non-load bearing wall. The maximum opening may not exceed eight feet. The vertical distance to the parallel surface above must be not more than 24 inches. Cripples and blocking are not required above the header. Cavities above the headers must be insulated on exterior walls.

### Plan Review

1. Verify that the framing details do not call out headers only for non-bearing interior or exterior walls.



2. Verify that the horizontal span for each rough window and door opening is no greater than eight feet.
3. Verify that the header height between the header and the next parallel framing member above the header is not greater than two feet. The next vertical parallel framing member will typically be a top plate.

## Field Inspection

### Framing Inspection

1. Verify that the horizontal rough opening framed out in the wall assembly matches, or is less than, the openings called out on the approved building plans.
2. Verify that the distance between the header and the next parallel framing member (typically the top plate) is no greater than 24 inches.

### Insulation Inspection

1. Verify that the framing cavity above the header is insulated to the required insulation R value called out on the approved plans or documentation.

## Code Citations\*

### IRC 2006 and 2009, Section R602.7.2

Nonbearing walls. Load-bearing headers are not required in interior or exterior nonbearing walls. A single, flat 2-inch-by-4-inch (51 mm by 102 mm) member may be used as a header in interior or exterior nonbearing walls for openings up to 8 feet (2438 mm) in width if the vertical distance to the parallel nailing surface above is not more than 24 inches (610 mm). For such nonbearing headers, no cripples or blocking is required above the header.

### IRC 2006 and 2009 Table R702.3.5 Minimum Thickness and Application of Gypsum Board

Allows the use of 24-inch-on-center framing for fastening gypsum board with fasteners and with or without adhesive 1/2 inch thickness or greater.

### IRC 2006 and 2009 Section R703 Exterior Covering

Structural sheathing and siding requirements are based on Table R703.4. Note that footnote #a# specifies that the table is based on 16 inches on center and that studs-spaced-24-inches-on-center siding shall be applied to sheathing approved for that spacing.

## References

\*Copyright, 2009, [International Code Council](#), Inc. Falls Church, Virginia. 2009 International Residential Code. Reproduced with permission. All rights reserved.

\*Copyright, 2006, [International Code Council](#), Inc. Falls Church, Virginia. 2006 International Residential Code. Reproduced with permission. All rights reserved.